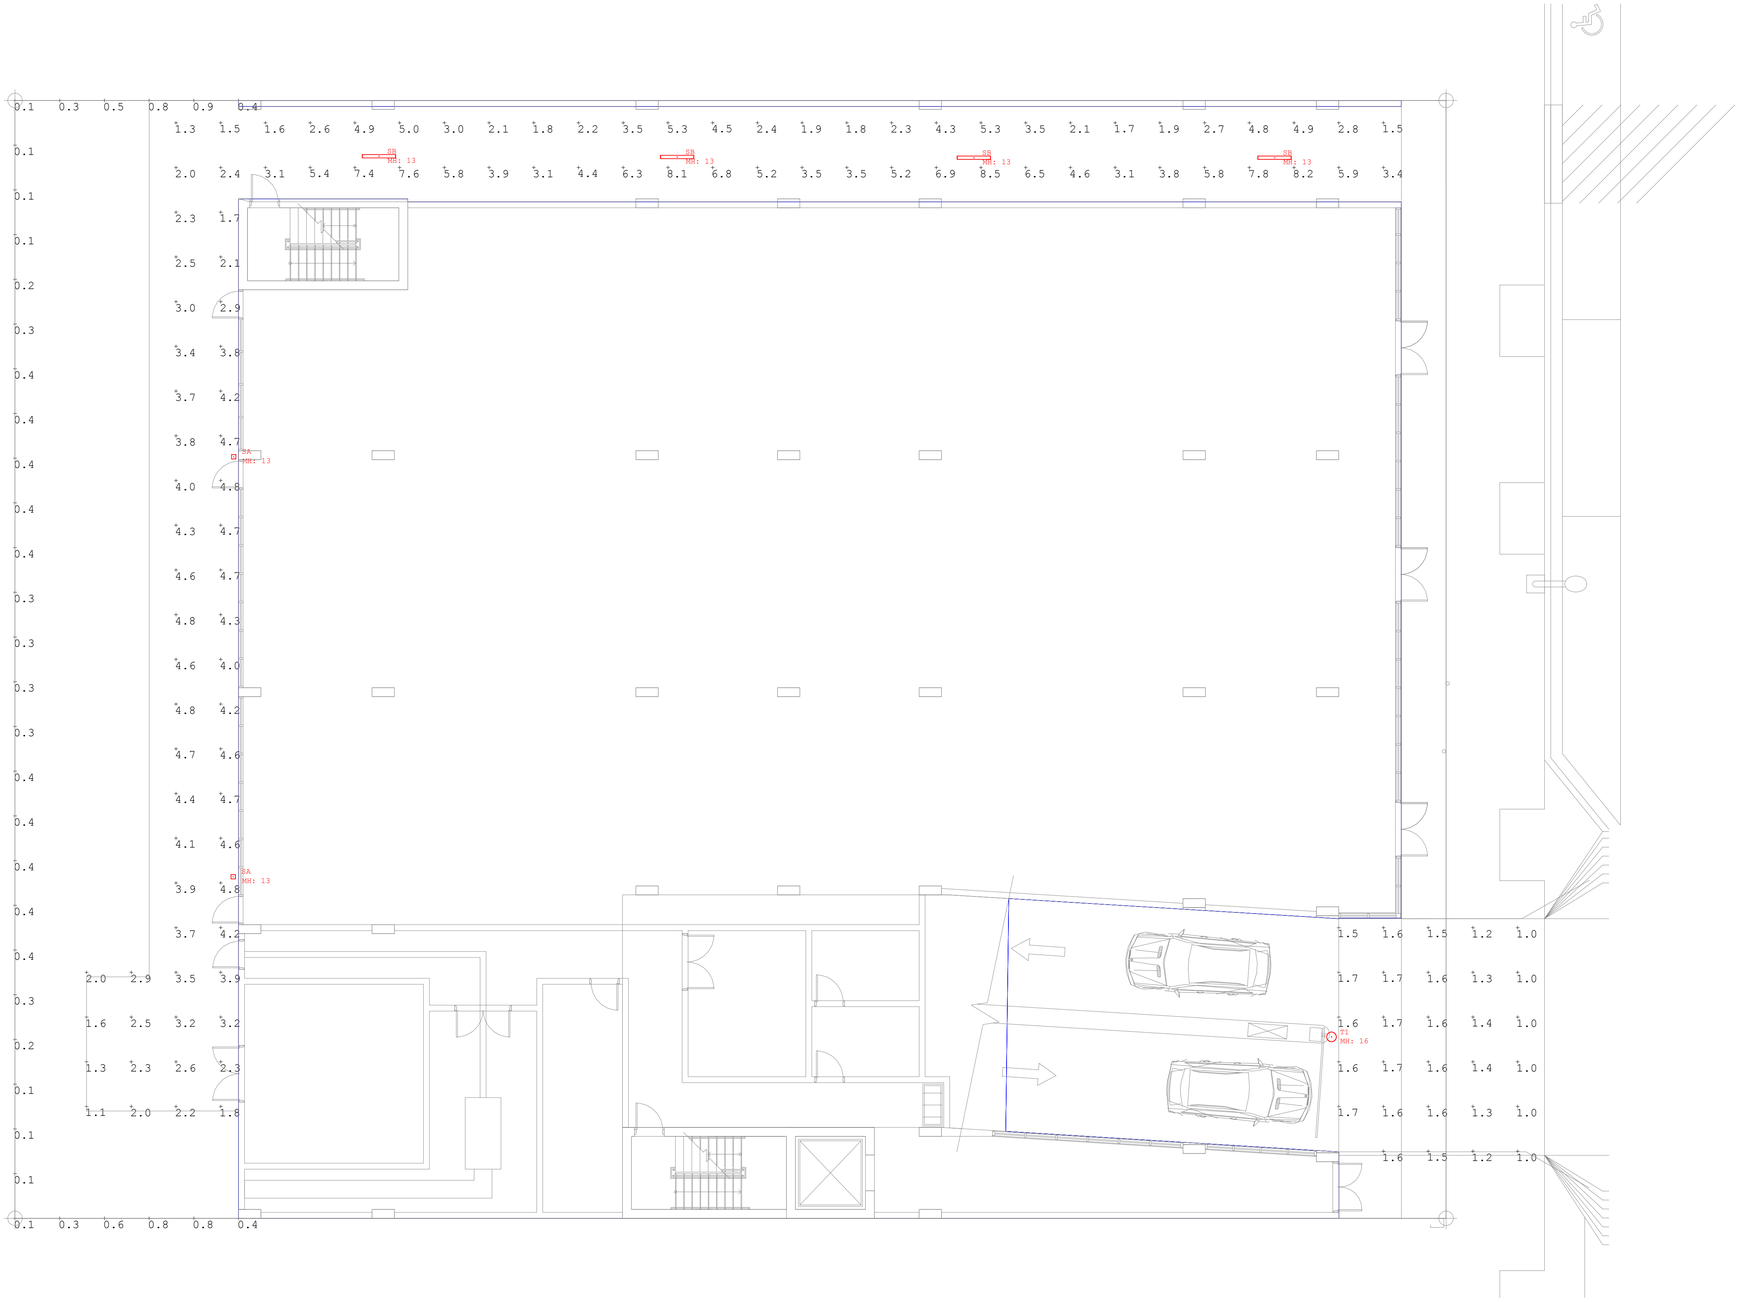

Luminaire Schedule						
Symbol	Qty	Label	Arrangement	Total Lamp Lumens	LLF	Description
	2	SA	SINGLE	N.A.	0.900	EATON#: GLEON-AE-01-LED-E1-T2
	4	SB	SINGLE	N.A.	0.500	EATON#: 4SWLED-LD4-20SL-LC-UNV-L840-CD1-U
	1	T1	SINGLE	N.A.	0.900	TT-B4-LED-E1-WQ

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
PROPERTY LINE	Illuminance	Fc	0.36	0.9	0.1	3.60	9.00
SITE LIGHTING	Illuminance	Fc	3.31	8.5	1.0	3.31	8.50

LIGHTING DYNAMICS INCORPORATED

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine applicability of the layout to existing or future field conditions. This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions utilizing current industry standard lamp ratings in accordance with Illuminating Engineering Society approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps and other variable field conditions.

NOTES:

No.	Revision/Issue	Date
1	PHOTOMETRIC STUDY	07/21/16

LIGHTING DYNAMICS, INC.
7835 West Commercial Blvd.
Tamarac, FL 33351
(954) 944-0286
www.lightingdynamics.com

Project Name and Address

929 ALTON ROAD
SITE LIGHTING PLAN - OPTION 2
MIAMI BEACH, FL

FILE J:\PROJECTS\2016\JULY
CLIENT IDEA

Project 929 ALTON ROAD
Date 07/21/16
Scale 1/8" = 1'
Sheet L1
DRAWN BY V. POP

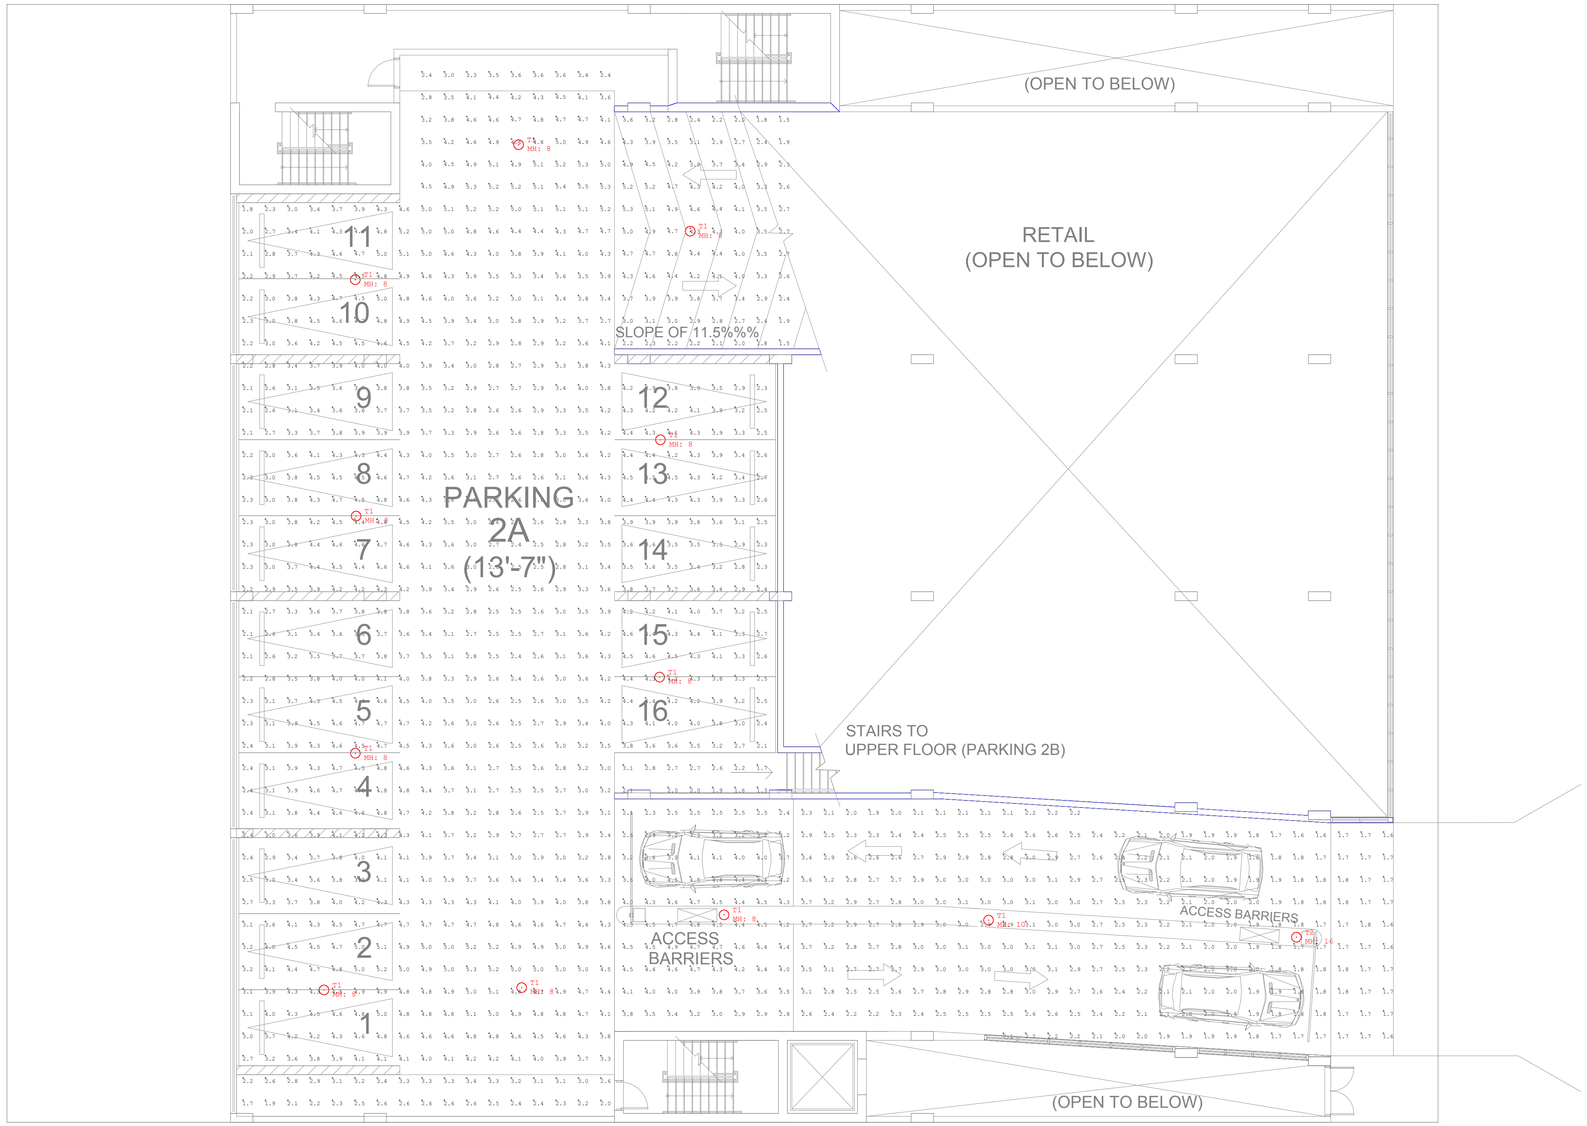

Luminaire Schedule					
Symbol	Qty	Label	Total Lamp Lumens	LLF	Description
	11	T1	N.A.	0.900	EATON#: TT-B2-LED-E1-WQ
	1	T2	N.A.	0.900	EATON#: TT-B4-LED-E1-WQ

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
PARKING LEVEL 2A	Illuminance	Fc	3.41	5.5	1.3	2.62	4.23

LIGHTING DYNAMICS INCORPORATED

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine applicability of the layout to existing or future field conditions. This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions utilizing current industry standard lamp ratings in accordance with Illuminating Engineering Society approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps and other variable field conditions.

NOTES:

No.	Revision/Issue	Date
1	PHOTOMETRIC STUDY	07/21/16

LIGHTING DYNAMICS, INC.
7835 West Commercial Blvd.
Tamarac, FL 33351
(954) 944-0286
www.lightingdynamics.com

Project Name and Address

929 ALTON ROAD
Parking Garage LEVEL 2A
MIAMI BEACH, FL

FILE J:\PROJECTS\2016\JULY
CLIENT IDEA

Project 929 ALTON ROAD
Date 07/21/16
Scale 1/8" = 1'
Sheet L1
DRAWN BY V. POP

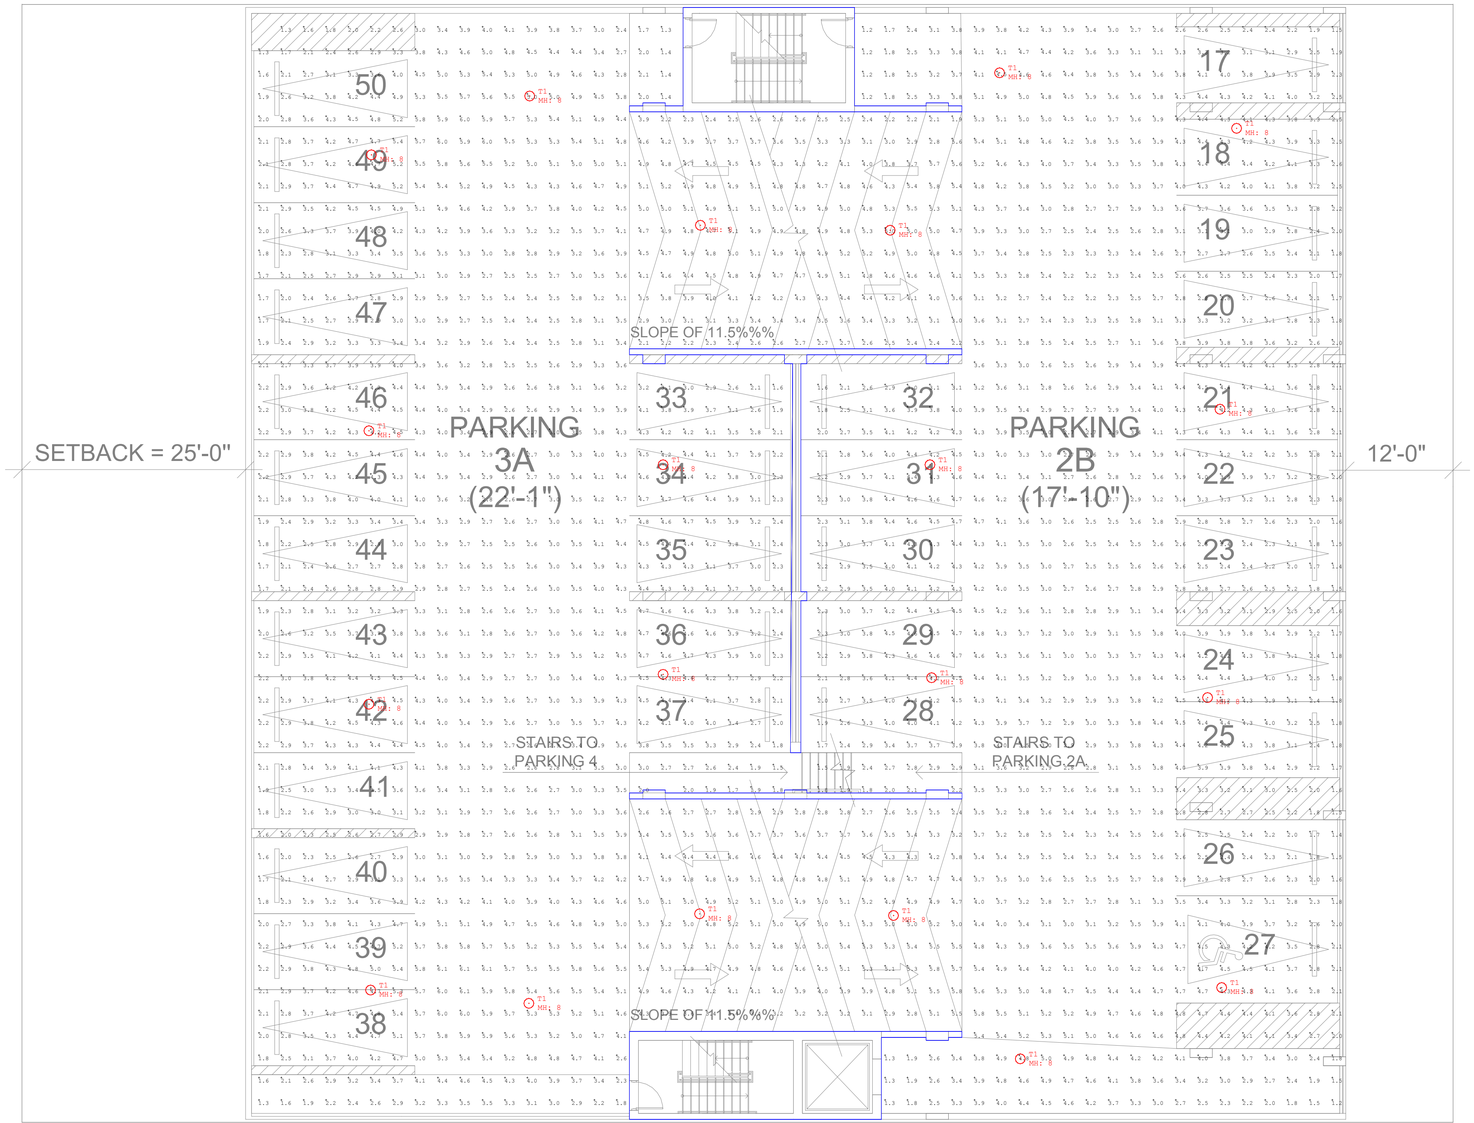

Luminaire Schedule					
Symbol	Qty	Label	Total Lamp Lumens	LLF	Description
	20	T1	N.A.	0.900	EATON#: TT-B2-LED-E1-WQ

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
PARKING LEVELS 2B & 3A	Illuminance	Fc	3.55	6.1	1.2	2.96	5.08

LIGHTING DYNAMICS INCORPORATED

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine applicability of the layout to existing or future field conditions. This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions utilizing current industry standard lamp ratings in accordance with Illuminating Engineering Society approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps and other variable field conditions.

NOTES:

No.	Revision/Issue	Date
1	PHOTOMETRIC STUDY	07/21/16

LIGHTING DYNAMICS, INC.
7835 West Commercial Blvd.
Tamarac, FL 33351
(954) 944-0286
www.lightingdynamics.com

Project Name and Address

929 ALTON ROAD
Parking Garage LEVEL 2B & 3A
MIAMI BEACH, FL

FILE J:\PROJECTS\2016\JULY
CLIENT IDEA

Project 929 ALTON ROAD
Date 07/21/16
Scale 1/8" = 1'
Sheet L1
DRAWN BY V. POP

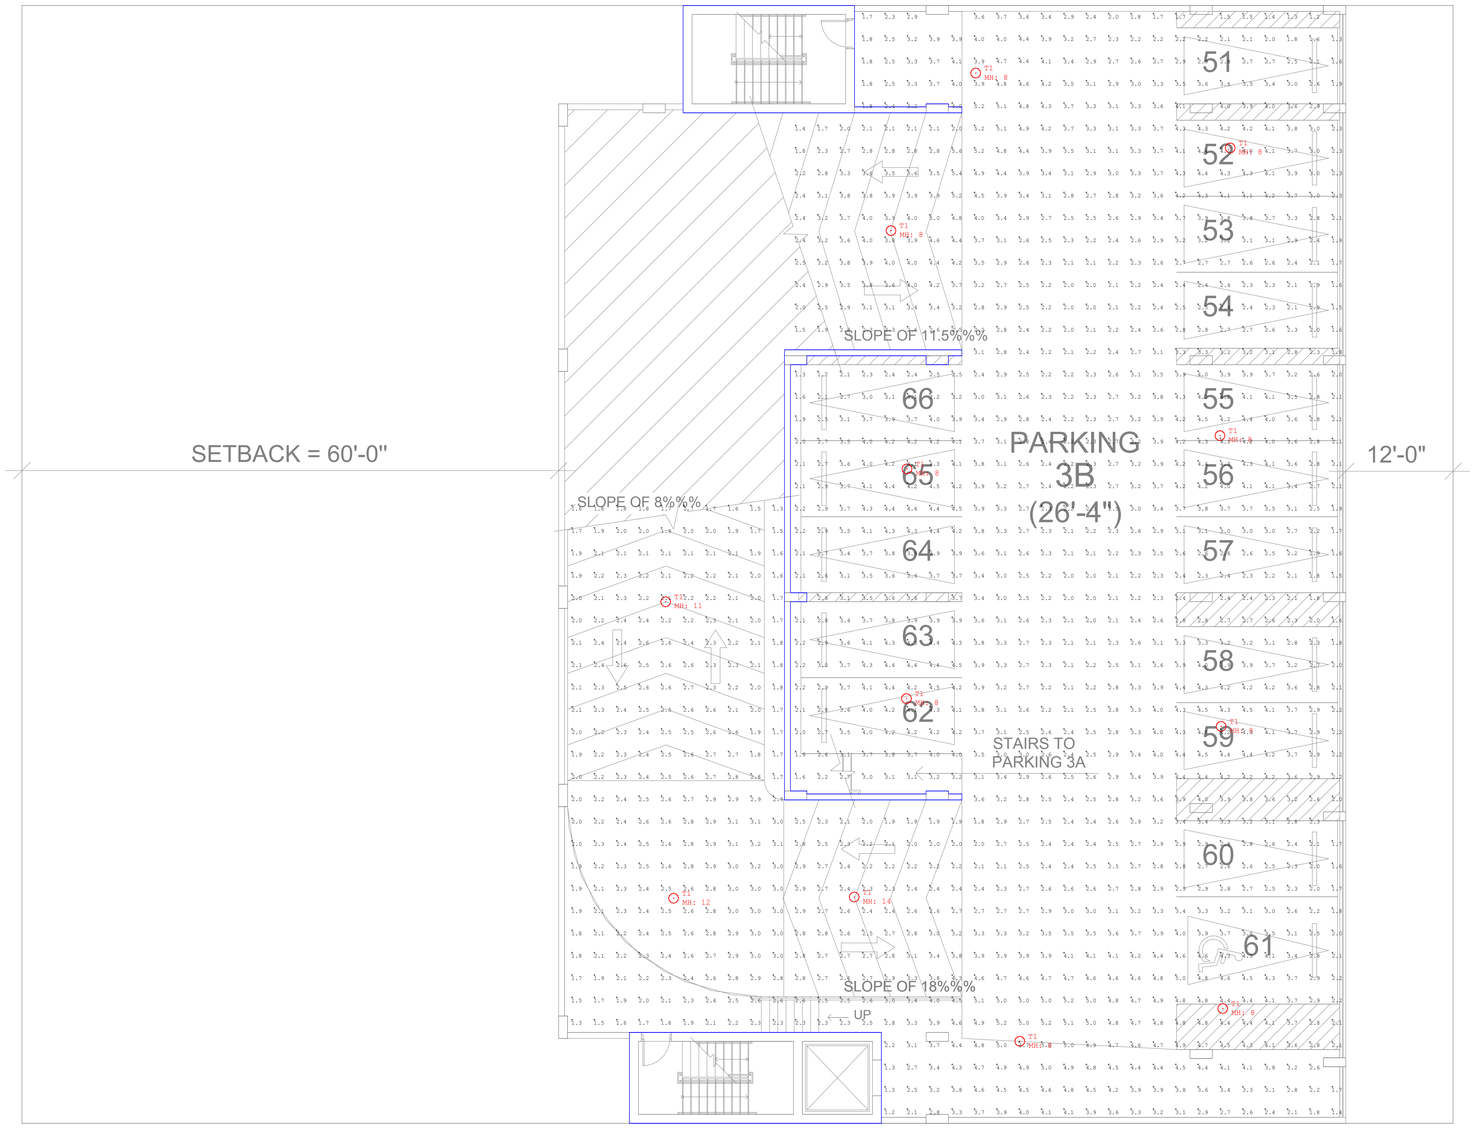

Luminaire Schedule					
Symbol	Qty	Label	Total Lamp Lumens	LLF	Description
	12	T1	N.A.	0.900	EATON#: TT-B2-LED-E1-WQ

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
PARKING LEVEL 3B	Illuminance	Fc	3.01	5.6	1.2	2.51	4.67

LIGHTING DYNAMICS INCORPORATED

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine applicability of the layout to existing or future field conditions. This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions utilizing current industry standard lamp ratings in accordance with Illuminating Engineering Society approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps and other variable field conditions.

NOTES:

No.	Revision/Issue	Date
1	PHOTOMETRIC STUDY	07/21/16

LIGHTING DYNAMICS, INC.
7835 West Commercial Blvd.
Tamarac, FL 33351
(954) 944-0286
www.lightingdynamics.com

Project Name and Address

929 ALTON ROAD
Parking Garage LEVEL 3B
MIAMI BEACH, FL

FILE J:\PROJECTS\2016\JULY
CLIENT IDEA

Project 929 ALTON ROAD
Date 07/21/16
Scale 1/8" = 1'
Sheet L1
DRAWN BY V. POP

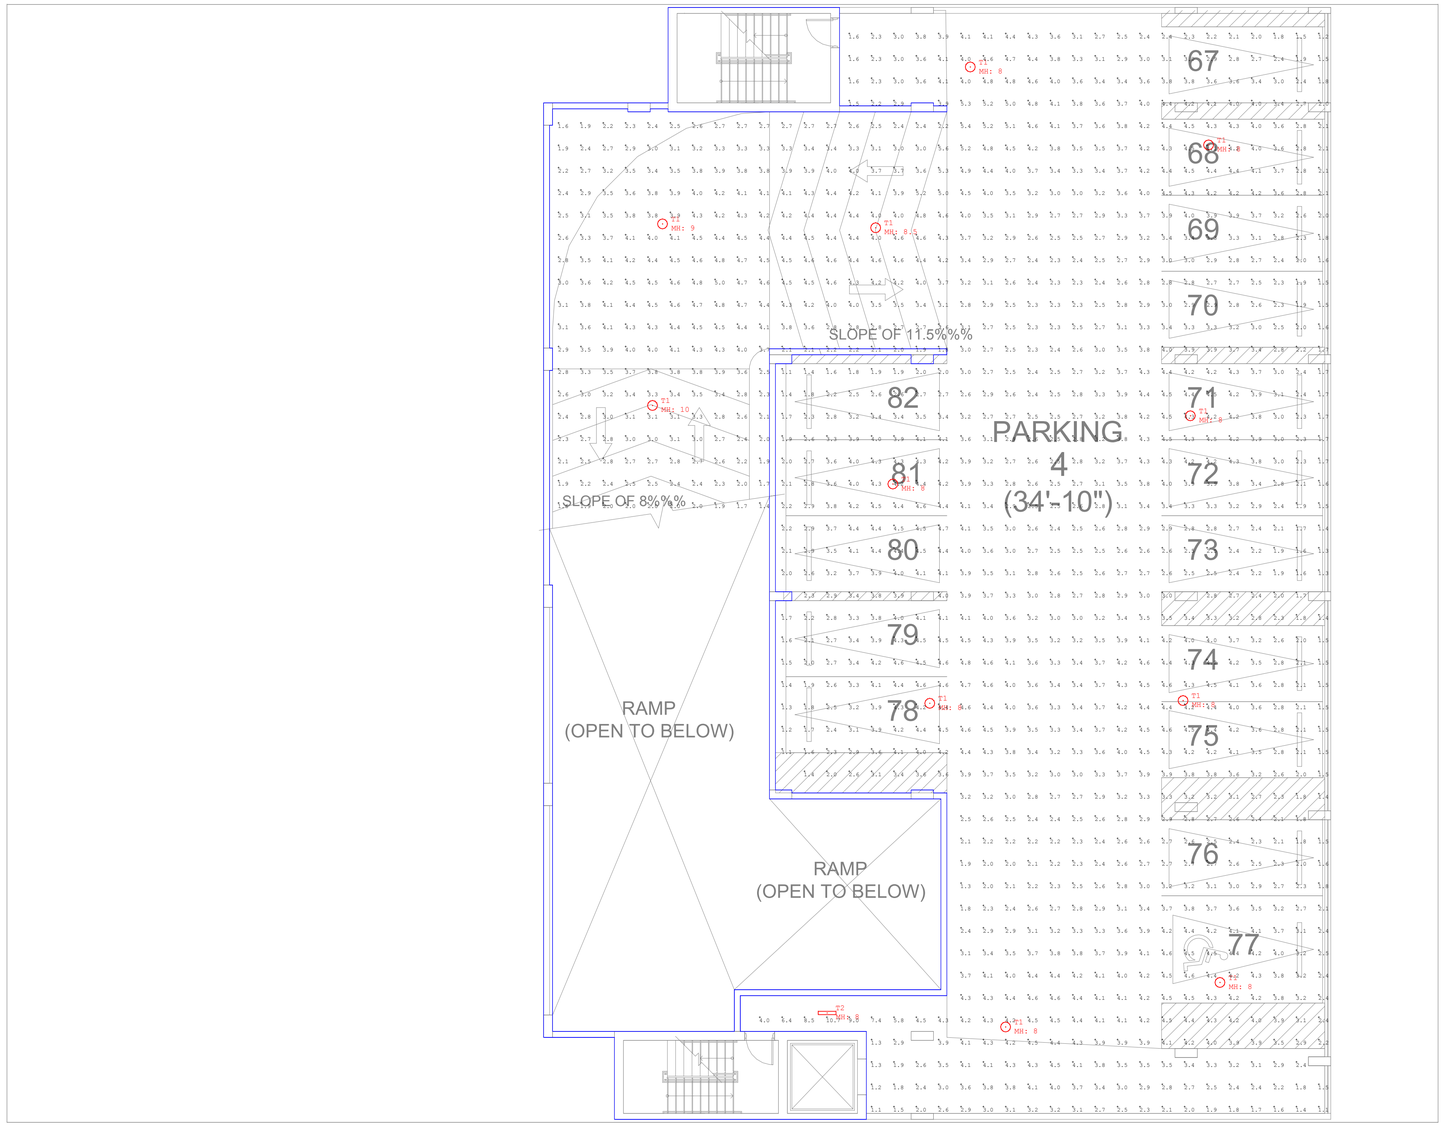

Luminaire Schedule					
Symbol	Qty	Label	Total Lamp Lumens	LLF	Description
	11	T1	N.A.	0.900	EATON#: TT-B2-LED-E1-WQ
	1	T2	N.A.	0.200	EATON#: 2SWLED-LD4-8SL-LC-UNV-L840-CD1-U

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
PARKING LEVEL 4	Illuminance	Fc	3.28	10.7	1.1	2.98	9.73

LIGHTING DYNAMICS INCORPORATED

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine applicability of the layout to existing or future field conditions. This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions utilizing current industry standard lamp ratings in accordance with Illuminating Engineering Society approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps and other variable field conditions.

NOTES:

No.	Revision/Issue	Date
1	PHOTOMETRIC STUDY	07/21/16

LIGHTING DYNAMICS, INC.
7835 West Commercial Blvd.
Tamarac, FL 33351
(954) 944-0286
www.lightingdynamics.com

Project Name and Address

929 ALTON ROAD
Parking Garage LEVEL 4
MIAMI BEACH, FL

FILE J:\PROJECTS\2016\JULY
CLIENT IDEA

Project 929 ALTON ROAD
Date 07/21/16
Scale 1/8" = 1'
Sheet **L1**
DRAWN BY V. POP